


FIRES AND FIRE PREVENTION

191 Attachment 1

City of Muskego

Fire Street Examples for Site Planning

1. Fire street example without parking

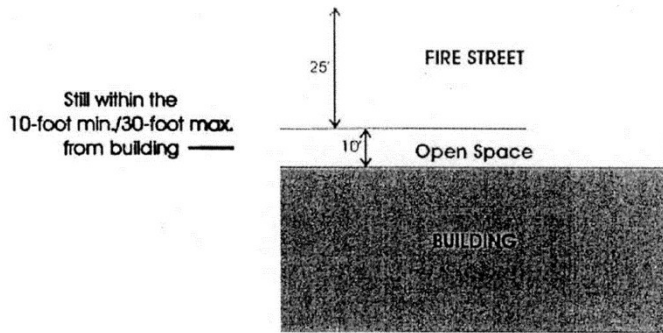


NOTES:

A fire street must extend for at least 50% of the length of at least one facade of a building.

A fire street must have at least 25 feet in width of unobstructed workable area, although a thirty-foot minimum is required when parking abuts both sides of the fire street. The fire street must be at least 10 feet and no more than 30 feet from the structure.

2. Fire street example with parking #1

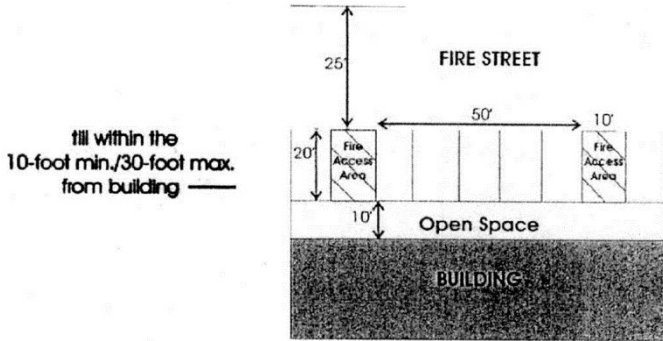

The first 10 feet of area dividing the fire street and the structure must consist of open space (walkway, greenway, parking, and landscaping are acceptable in this area as long as access is given to entryways).

If parking stalls are intended between the fire street and the building, there must be striped fire access points measuring 10 feet wide by 20 feet deep for every 50 feet of fire street.

3. Fire street example with parking #2

